

### Space Heating and Domestic Hot Water Production with Fully Zoned Underfloor

The [Kensa Compact heat pump](#) is specifically designed to provide space heating and domestic hot water (DHW) at the highest efficiency possible with the simplest installation. In space heating mode the system provides hot water into the [underfloor heating system](#) at generally a flow temperature of 35°C. For underfloor heating in a well insulated building this will provide adequate heating into the building at the heat pump's highest efficiency. If the insulation of the building is below current regulations then this flow temperature might need to be increased reducing the system's efficiency. Insulative floor coverings such as wood or thick carpets can also require higher flow temperatures.

If full zone control is required in all the underfloor areas then a [buffer vessel](#) is required to be fitted. The most efficient buffer vessel design for heat pumps is a two connection buffer vessel (as shown over) and fitting this will reduce short cycling while maintaining the highest efficiency of the heat pump. The underfloor manifolds should ideally be connected using a reverse return system as this will ensure even heat flow through the underfloor zones without the use of balancing valves and the resulting increase in water pump energy.

When the DHW time clock calls for production of DHW, the three-port valve diverts the flow from the heating distribution circuit into the indirect coil within the hot water cylinder. The temperature of the water from the heat pump is raised to approximately 50°C. When the DHW production time period ends, the three port valve switches back to the underfloor distribution and the temperature drops back to its space heating design temperature. The heat pump then reverts to space heating mode or switches off if no zones are calling for heat.

The maximum DHW temperature that the heat pump can achieve will depend on the type of heat pump fitted and will be between 50-65C. If 65°C is required all year round, it is recommended that a high temperature heat pump (R134a) is fitted or if a standard temperature heat pump (R407C) is fitted an immersion heater is linked to a second channel on the DHW timeclock and this is programmed to operate for a period immediately following the DHW production. This means that the majority of the heating load for the DHW is produced using the heat pump, as opposed to using only the direct immersion heater.


If 50°C water is acceptable, then it is also recommended that the immersion heater is programmed to raise the temperature to 65°C at least once a week using the DHW timeclock. The larger the coil within the tank, the better the heat transfer area and hence the better the DHW performance will be. Ideally the coil should be a minimum of 0.2 sqm of true surface area per kW output from the heat pump.

#### Facts at a glance:

- Highest possible efficiency  
The heat pump uses two temperature set points (one for the underfloor and one for the DHW production) to produce the required heating at the highest efficiency as opposed to using in built direct immersion heaters.
- 50°C DHW flow temperature  
Domestic Hot Water flow temperatures achieved at approximately 50°C
- Simple Installation  
Designed to simplify installation by removing the need for complicated control logic, balancing valves and hot water cylinder thermostats.
- Oversized DHW hot water coils are required  
The larger size the coil within the tank, the better the heat transfer area and hence the better the DHW performance will be. Due to the low flow temperatures generated by the heat pump the hot water tank must have an oversized coil to provide the correct heat transfer.

# Application (AIS)

AIS-Space Heating and DHW with Buffer Vessel - 4.0 Page(s)

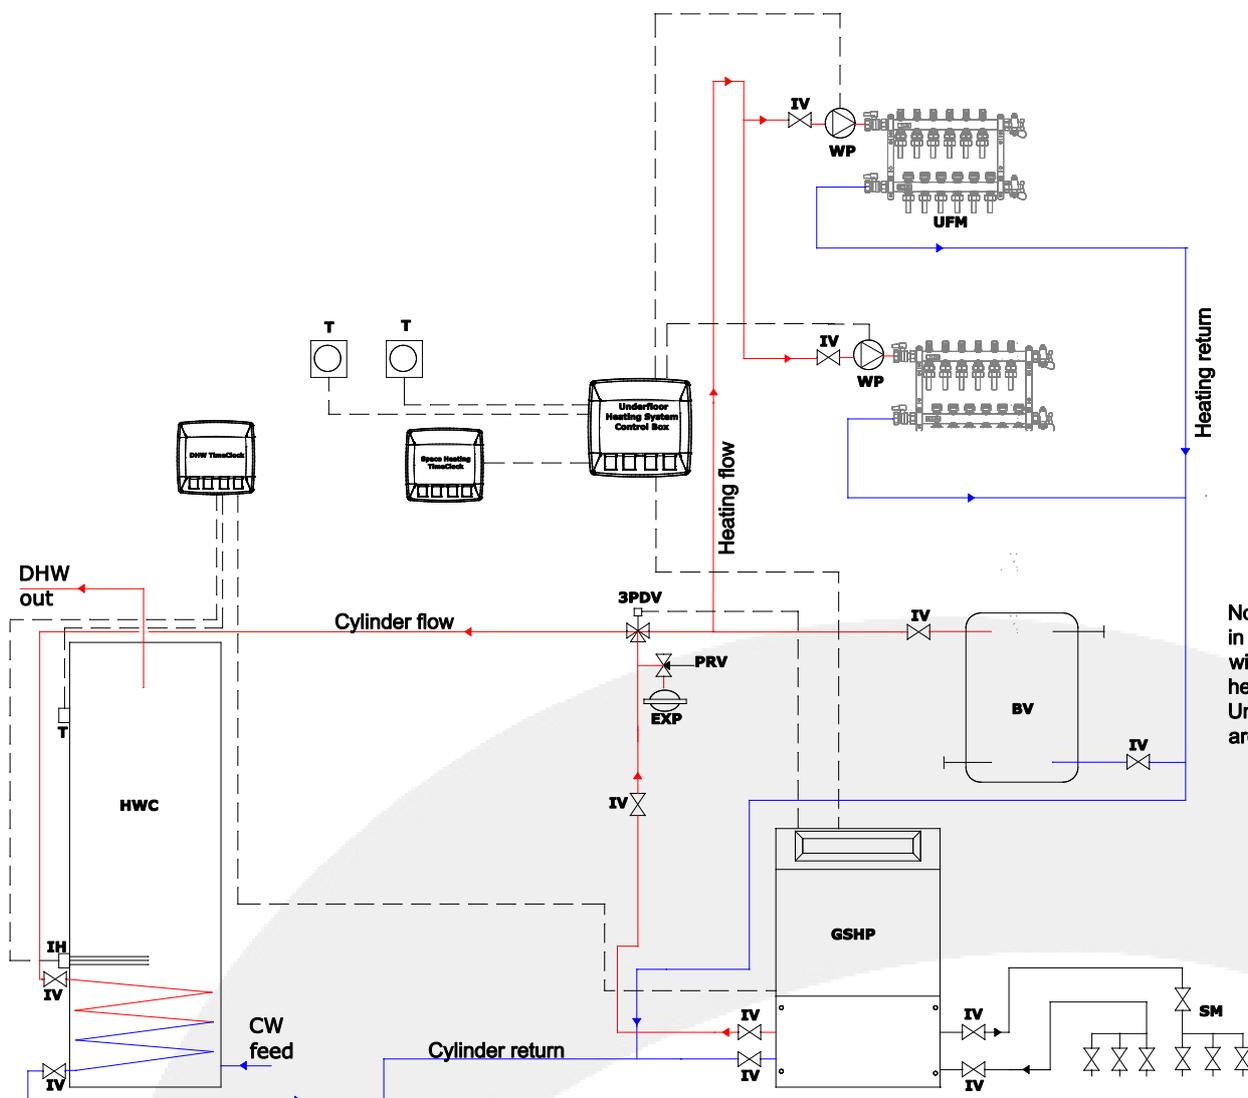

## Abbreviations

3PDV - 3 port diverting valve  
 BV - Buffer vessel  
 DHW - Domestic Hot Water  
 CW - Cold Water  
 EXP - Expansion vessel  
 GSHP - Ground source heat pump  
 IH - Immersion heater  
 IV - Isolation valve  
 PRV - Pressure relief valve  
 SM - Slinky manifold  
 UFM - Underfloor manifold  
 WP - Water pump

Please note:- The above drawing is a schematic only and additional valves and fittings maybe required.

Please note:- Kensa supply is the ground source heat pump, slinky manifold and 3 port diverting valve. Kensa also supplies the horizontal ground arrays and antifreeze (not shown above).

The buffer vessel (BV) is fitted to reduce short cycling of the heat pump while still allowing full zone control of the underfloor.